



PRODUCT DOCUMENT PACK

Prepared and distributed by KW Commercial Kitchen

PRODUCT

Woodson W.CHD750 Countertop Filtration System – 750mm, NCC-2022 Certified

Model / SKU: W.CHD750


KW COMMERCIAL KITCHEN

7/72 Canterbury Road, Bankstown NSW 2200

Phone 1300 001 366

Email sales@kwcommercial.com.au

Web www.kwcommercial.com.au



Scan for the current KW product page

DOCUMENT NOTICE

The supplier document begins on the next page. KW contact branding is added in a separate footer area and does not replace the supplier's instructions, specifications or warranty terms.

w.chd750 e2 datasheet

SKU: W.CHD750

Distributed by KW Commercial - kwcommercial.com.au

Manufacturer documentation - (c) Woodson

Retrieved: 2026-07-08

<https://www.kwcommercial.com.au/product/woodson-w-chd750-ductless-hood>

Product Information

- Improves cooking environments where ducted local exhaust systems are not required by the National Construction Code (NCC)
- Reduces greasy deposits forming on benches, floors, walls and ceilings from cooking activities
- Improves the air quality for kitchen staff by capturing the cooking emissions and filtering the air for recirculation within the workspace
- Air is drawn up through multistage filters and then returned to the kitchen through the front facing louvres above
- LED lighting and multi-speed fan

Application

- From revision E onwards, all Woodson countertop filtration systems (W.CHD750 and W.CHD1000) are certified to meet the performance requirements¹ of NCC-2022 through deemed to satisfy and performance solution provisions
- Tested and certified for Australia & New Zealand
- Certified as a recirculating performance solution without connection to ductwork and with a reduced cooking surface to filter separation
- Certified for use with electrical cooking equipment including fryers
- Certified for a total equipment power rating of up to 10kW
- The unit **MUST NOT** be used with gas or solid-fuel fired equipment
- The multi-stage filtration reduces contaminants effectively to comply with the indoor air quality limits as per NCC-2022: F6V1 in an environment with adequate background ventilation
- Smoke emissions are reduced by the multi-stage filters²
- Adequate mechanical or natural ventilation must be provided to remove the heat and humidity from the room as per NCC-2022: F6P4 & F6D6
- Check with local authorities for any regulations in addition to the ventilation requirements of the NCC*





Specifications

Model	W.CHD750
W x D x H (mm)	750 x 660 x 1150
Max. Equipment Cooking Surface W x D (mm)	684 x 600 (600 from the back edge of the unit)
Max. Equipment Height (mm)	414
Airflow (l/s)	125 - 215
Sound Pressure (dB(A))*	60
Total Connected Load	0.5kW
Electrical Connection	240VAC / 50Hz (10A plug & lead)

*A-weighted sound pressure level at 0.5m distance from the air discharge grille at 125 l/s (W.CHD750) and at 220 l/s (W.CHD1000).

¹The NCC-2022 requires an environment with sufficient outdoor air supply provision (F6P3), mechanical ventilation to control odours and contaminants (F6P4) and adequate disposal of contaminated air (F6P5)

² Reduction of visible smoke > 80% (E2) via the multi-stage filtration

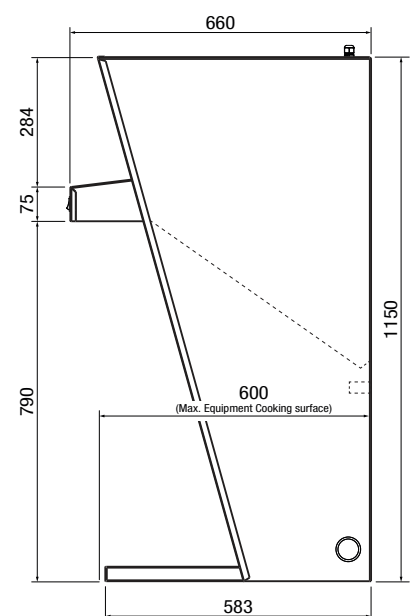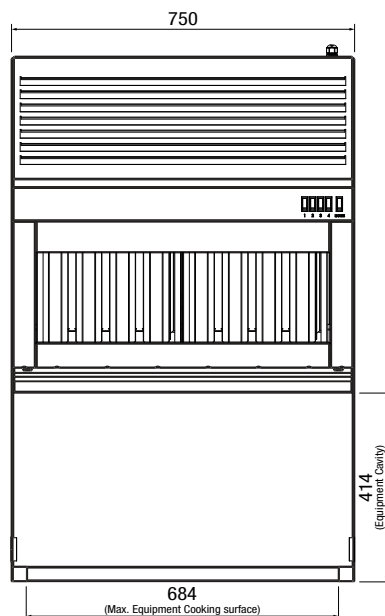

www.stoddart.com.au

www.stoddart.co.nz

Revision: E - 19/11/2024 - 01

Due to continuous product research and development, the information contained herein is subject to change without notice.

